



ISO VIEW

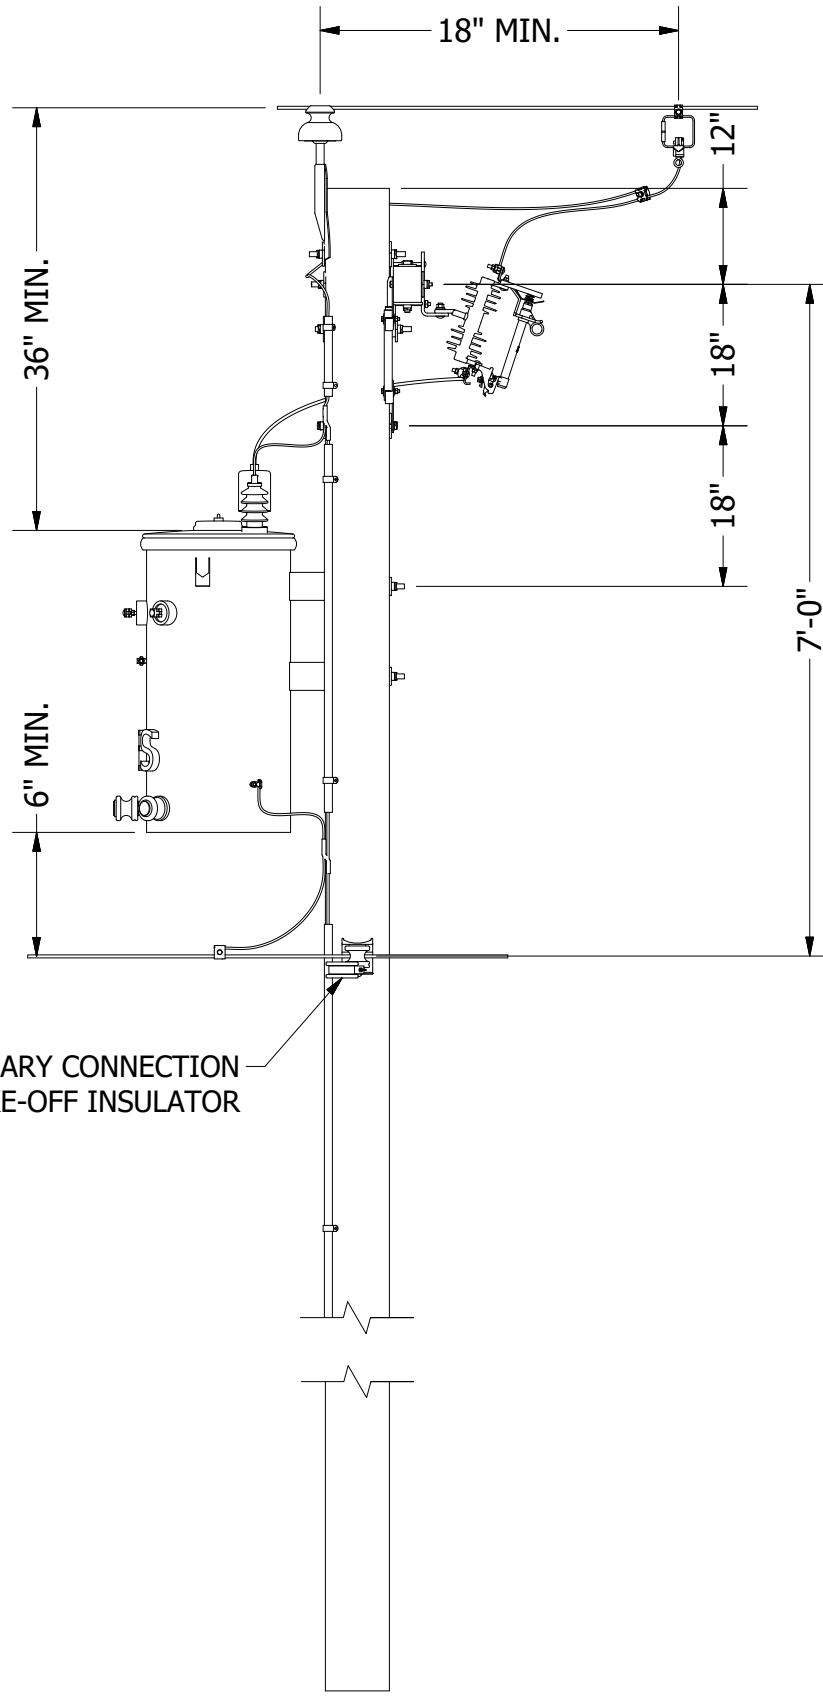

SIDE VIEW

SECONDARY CONNECTION  
TO TAKE-OFF INSULATOR

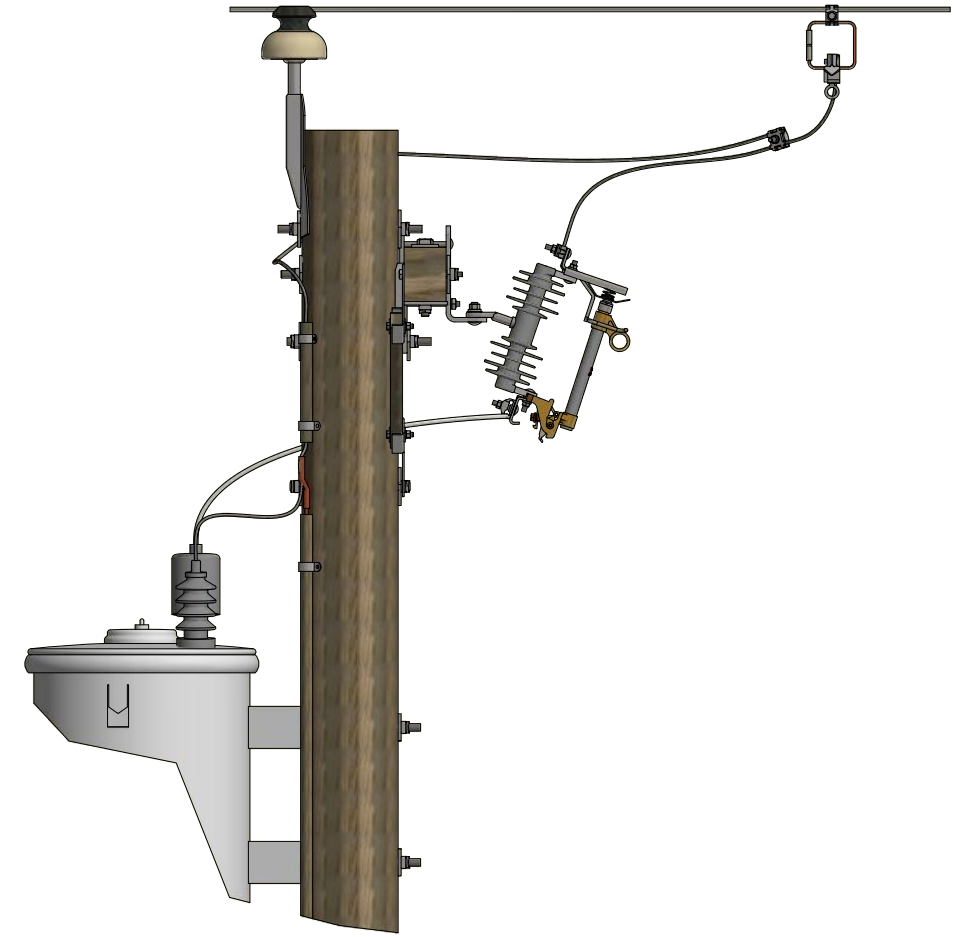

DETAIL VIEW

NOTES

- (1) MAKE ALL SERVICE CONNECTIONS UNDER THE TRANSFORMER.
- (2) SEE SPEC. 1851 FOR POLE GROUND.
- (3) THIS DIMENSION MAY VARY FOR DIFFERENT APPLICATIONS.
- (4) BRACKETS FOR 500 MCM COPPER OR WHERE THERE IS NO SECONDARY MAIN.
- (5) TRANSFORMER TANK GROUND TO NEUTRAL.

REV	DESCRIPTION	APPROVED	DATE
1			
2			
3			
4			
5			

REVISIONS	NETWORK:	BASE	
	W.O.	DRAWN BY	J. BROGAN
	JOB:	DESIGNED BY	
	D.N.:	CHECKED BY	
	STR.:	CHECKED BY	
		APPROVED BY	



1Ø CONVENTIONAL TRANSFORMER 50 kVA  
OR LESS ON A 1Ø 40 FT. POLE  
1651.1\_\_\_\_

SCALE:  
DRAWING NO.  
1651.1  
SHT. 1 of 1